



**2023 Northport Village
Flow Bod TSS Data**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec
Flow Avg	permit limit 63,000 gpd											
Gals	27950	16643	19258	13383	17246	18085	27178	23961	18124	25692	13338	30030
BOD mg/l	permit limit 203 mg/l monthly average											
max	200	180	380	354	200	250	260	350	420	390	170	150
avg	174	148	183	164	154	175	203	298	333	181	126	113
TSS mg/l	permit limit 145 mg/l monthly average											
max	14	9.2	13	13	13	16	16	19	18	17	14	5.8
avg	10	8.7	10	9	9	12	15	17	15	8	8	4.6

2023 Daily Flow Average

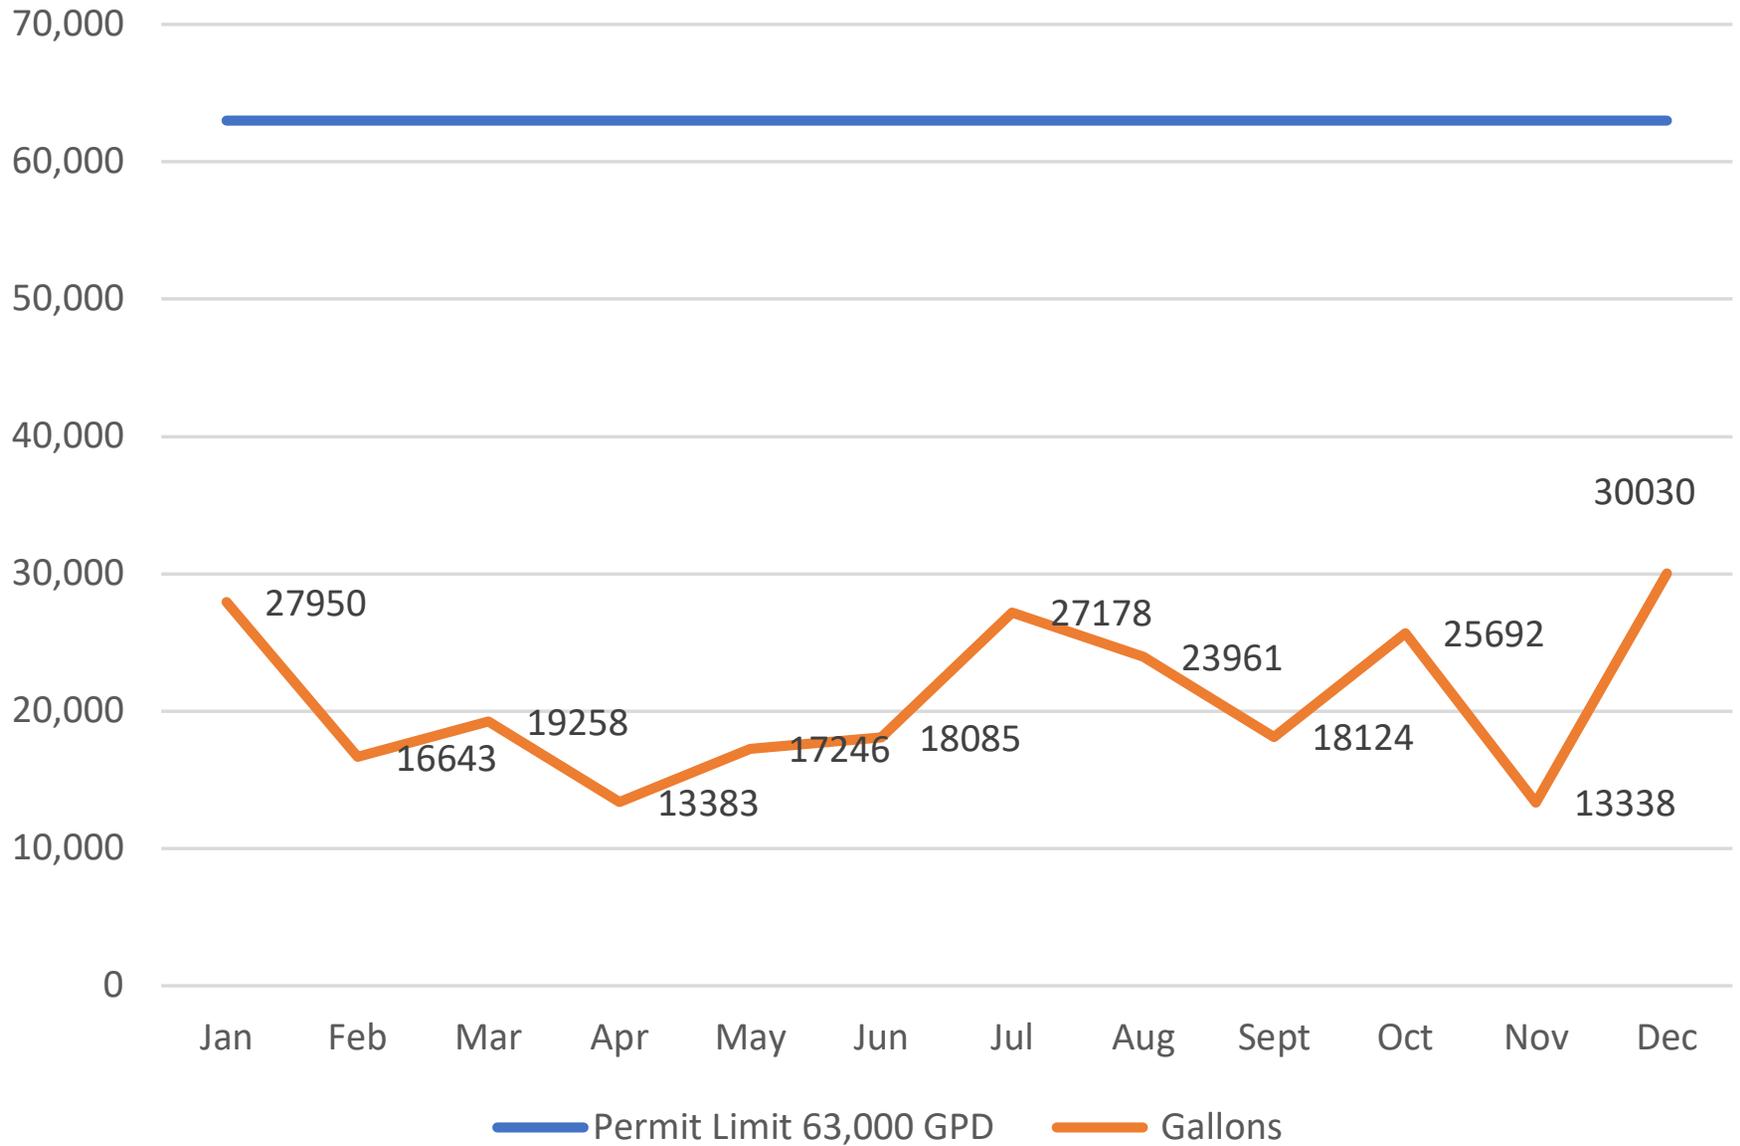


2023 TSS (mg/L)

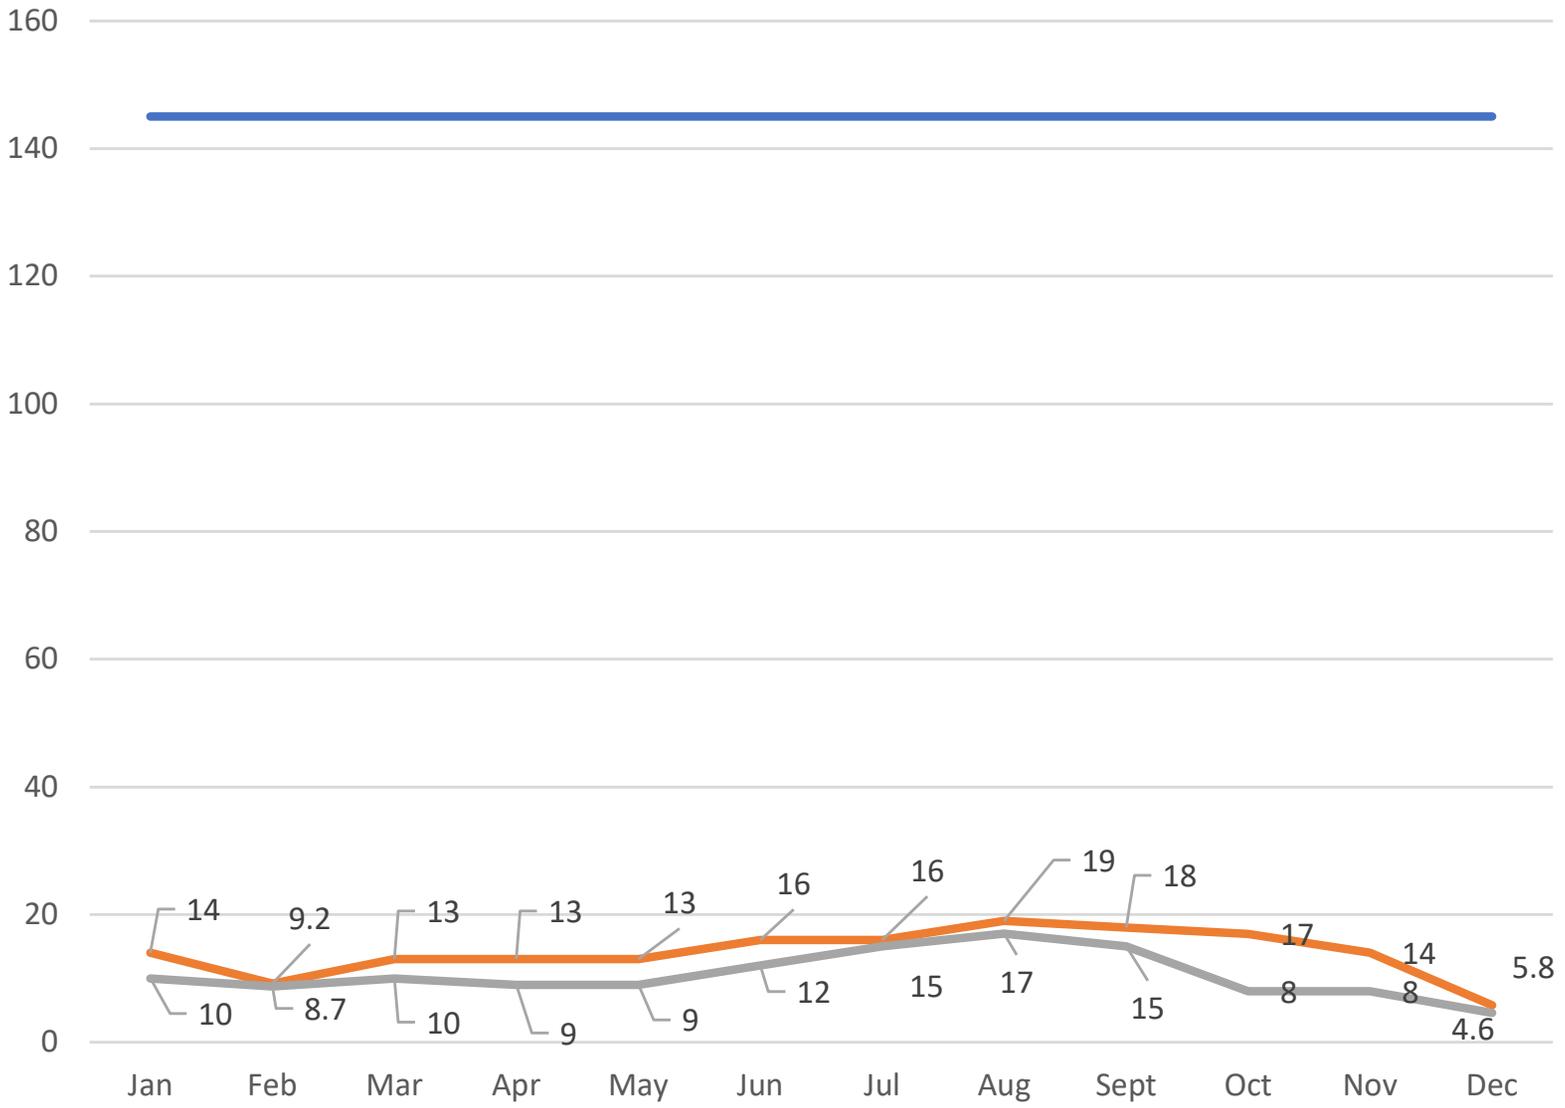

— Permit Limit (145 mg/L) — Max — Avg.

2023 BOD (mg/L)

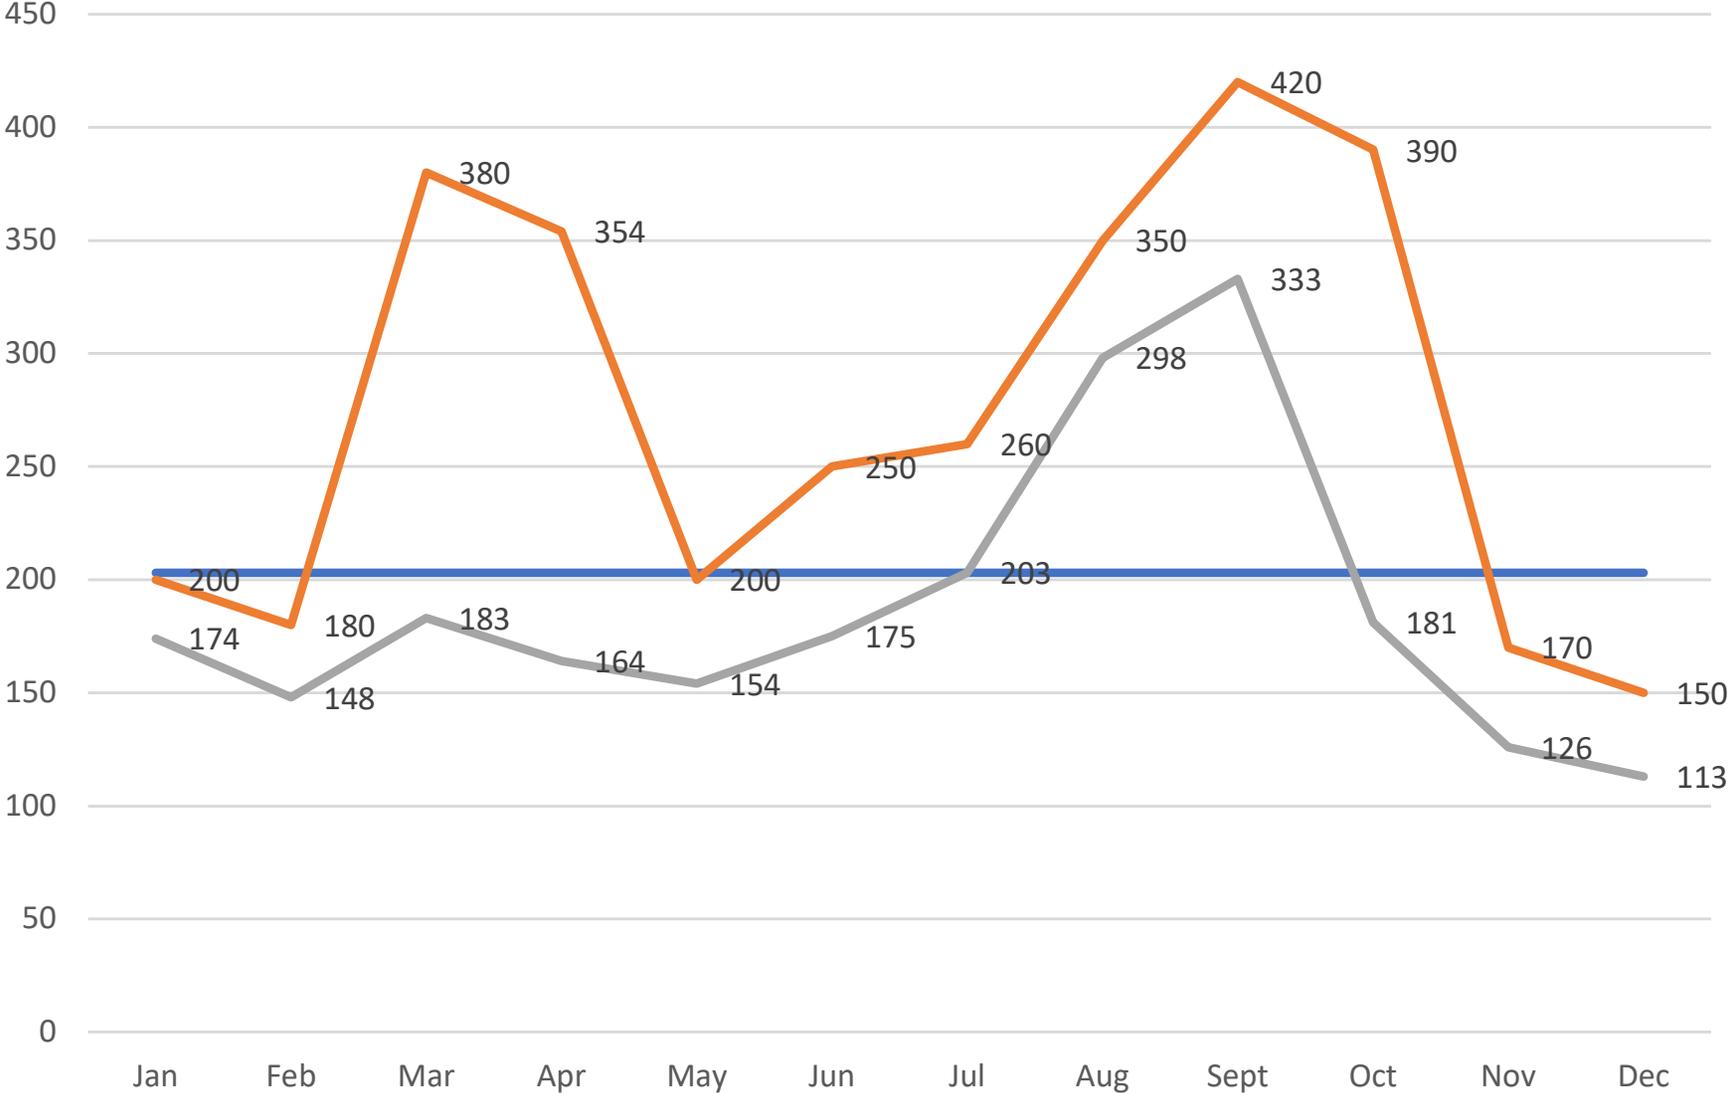

— Permit Limit (203 mg/L) — max — avg