


2023 - Jan 24 Northport Village


Flow Bod TSS Data

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	24-Jan
Flow Avg	permit limit 63,000 gpd												
Gals	27950	16643	19258	13383	17246	18085	27178	23961	18124	25692	13338	30030	18633
BOD mg/l	permit limit 203 mg/l monthly average												
max	200	180	380	354	200	250	260	350	420	390	170	150	240
avg	174	148	183	164	154	175	203	298	333	181	126	113	192
TSS mg/l	permit limit 145 mg/l monthly average												
max	14	9.2	13	13	13	16	16	19	18	17	14	5.8	7.7
avg	10	8.7	10	9	9	12	15	17	15	8	8	4.6	6

2023-Jan 24 Daily Flow Average

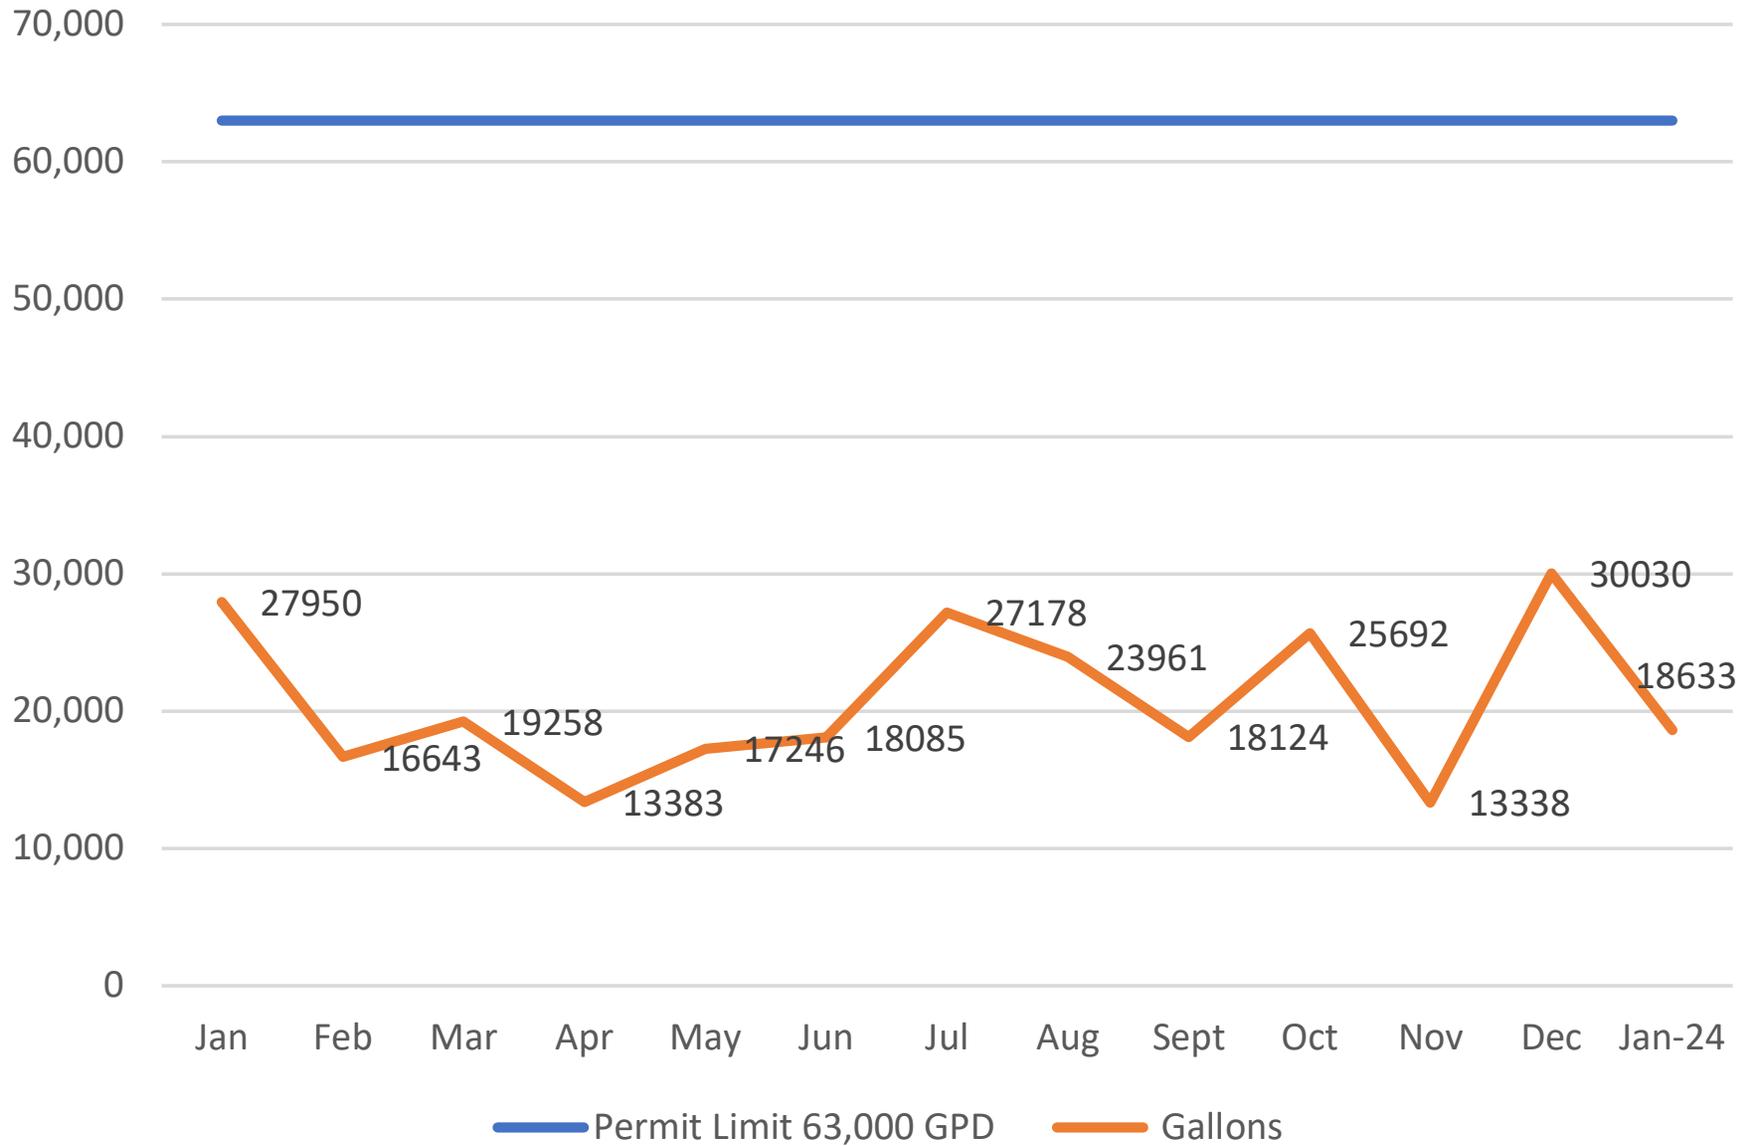

2023 - Jan 24 BOD (mg/L)

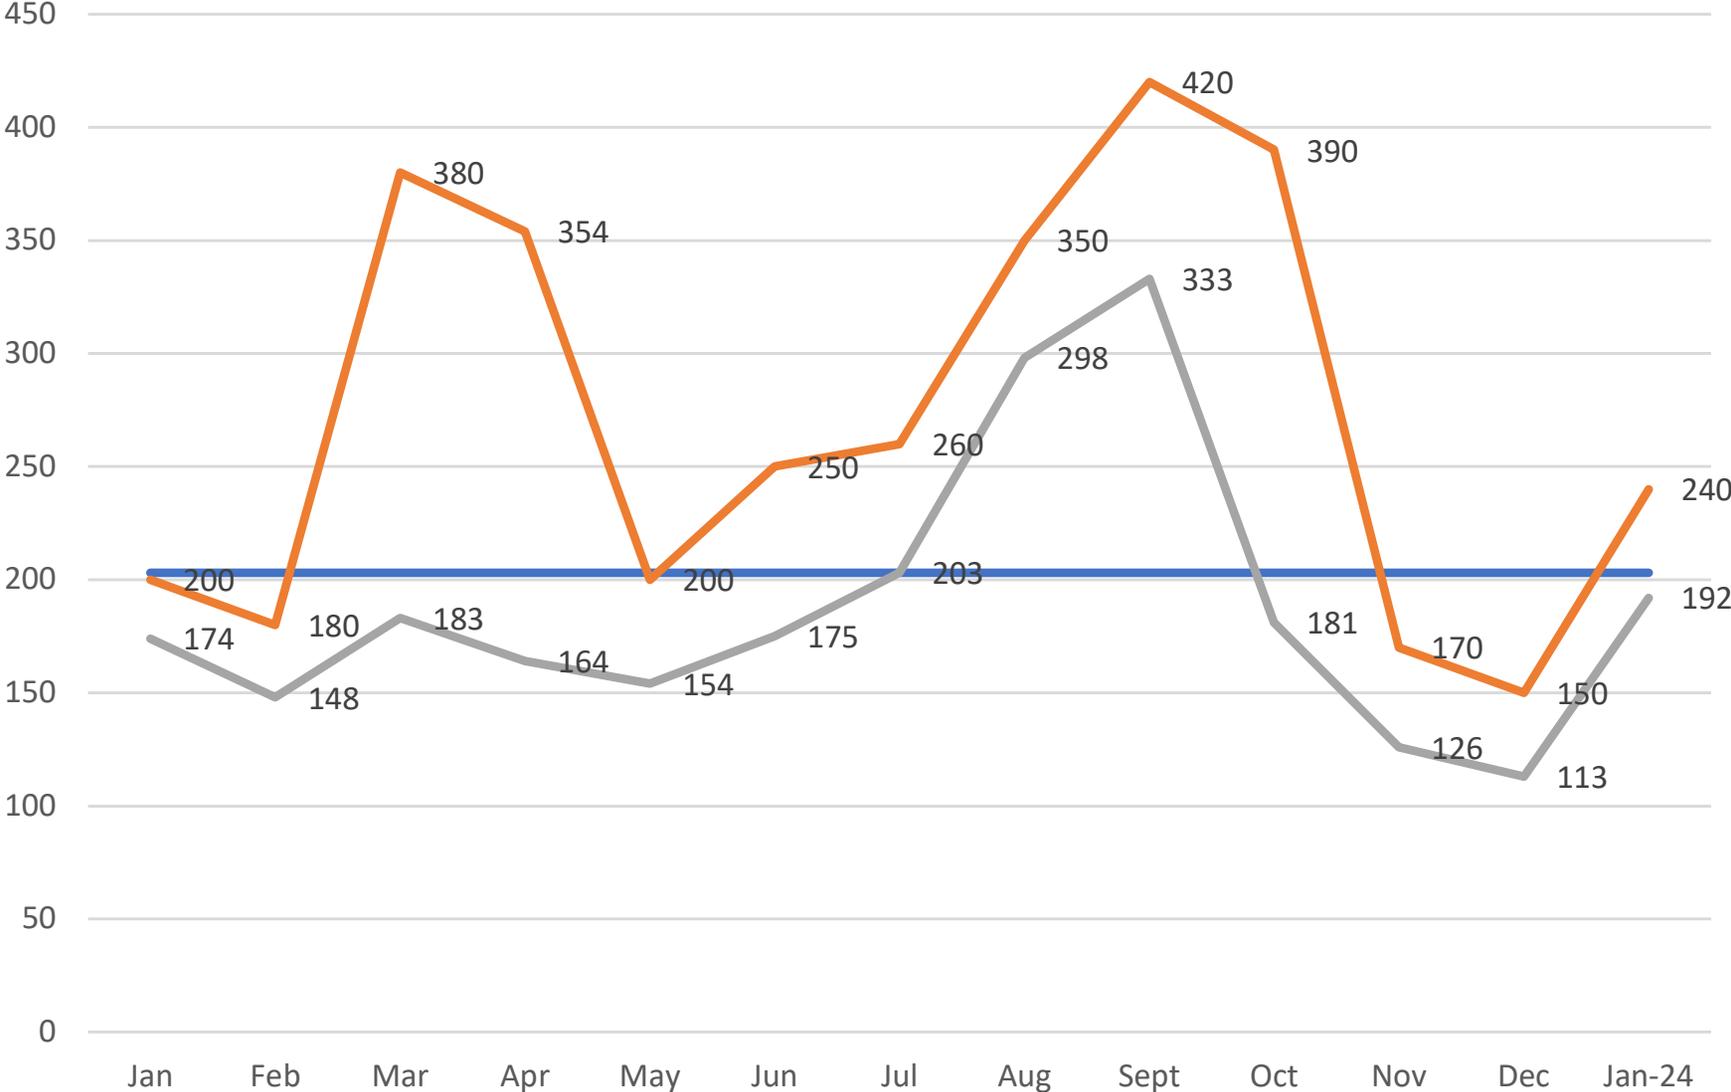

— Permit Limit (203 mg/L) — max — avg

2023-Jan 24 TSS (mg/L)

